

# Photoelectrics Amplifier Type S142B..

CARLO GAVAZZI



- $\mu$ -Processor controlled
- Amplifier relay for photoelectric switches
- Automatic or manual emitter power regulation
- Self-diagnostic functions
- Alignment help
- Rated operational voltage:  
24 VAC/DC, 24 VAC, 115 VAC or 230 VAC
- Output 8 A/250 VAC SPDT relay and 100 mA NPN
- LED indication: Automatic gain, output, level, emitter or receiver fault



## Product Description

$\mu$ -processor controlled amplifier for one set of photoelectric through beam sensors, type MOF., MMF. and MNF (see separate datasheet for MMFTR15 and MOFT20). Utilizes an 11-pin circular plug for easy connection.

8 A SPDT relay output, NPN / PNP transistor output or

alarm output. Diagnostics for sensor test during operation. Alignment help via LED or alternation of alarm output. Level indication for dirt accumulation. Manual or automatic emitter power regulation. Two emitter codes available for high neighbour immunity. ON- or OFF delay adjustable up to 10 sec.

## Ordering Key

**S142 B RNN 924**

Type \_\_\_\_\_  
 Special function \_\_\_\_\_  
 Output type \_\_\_\_\_  
 (R-Relay, N-NPN, P-PNP, T-Test)  
 Power supply \_\_\_\_\_

## Type Selection

Function	Ordering no. Supply: 24 VAC/DC	Ordering no. Supply: 24 VAC	Ordering no. Supply: 115 VAC	Ordering no. Supply: 230 VAC
NPN output & Test input	<b>S142 B RNT 924</b>		<b>S142 B RNT 115</b>	<b>S142 B RNT 230</b>
NPN output & Alarm output	<b>S142 B RNN 924<sup>1)</sup></b>	<b>S142 B RNN 024<sup>1)</sup></b>	<b>S142 B RNN 115<sup>1)</sup></b>	<b>S142 B RNN 230<sup>1)</sup></b>
PNP out., PNP Alarm & Test	<b>S142 B PPT 924</b>		<b>S142 B PPT 115</b>	<b>S142 B PPT 230</b>

<sup>1)</sup> Amplifier replacement for S1421156xxx  
 All amplifiers are provided with ON & OFF delay

## Specifications

<b>Rated operational voltage (U<sub>B</sub>)</b> Pins 2 & 10	230 115 024 924	195 to 265 VAC, 45 to 65 Hz 98 to 132 VAC, 45 to 65 Hz 20.4 to 27.6 VAC, 45 to 65 Hz 20.4 to 27.6 VAC/DC Class 2	Alarm	NPN / PNP, 100 mA, 10-40 VDC Delay on alarm 10 sec
<b>Rated operational power</b> AC supply AC/DC supply	3.3 VA 1.6 VA / 1.4 W		<b>Test input (Mute)</b> Emitter Enabled Emitter Disabled I <sub>max</sub> @ 40 VDC	<b>NPN</b> > 5.0 VDC < 3.0 VDC 1 mA <b>PNP</b> < V <sub>CC</sub> - 3 VDC > V <sub>CC</sub> - 5 VDC
<b>Delay on operate (t<sub>v</sub>)</b>	< 300 mS		<b>Protection output</b> transistor	Reverse polarity, short circuit and transients
<b>Outputs</b> <b>Relay Rating (AgCdO)</b> Resistive loads AC1 DC1 or Electrical life (typical) AC1	$\mu$ (micro gap) 8 A / 250 VAC (2500 VA) 0.2 A / 250 VDC (50 W) 2 A 25 VDC (50 W) > 100.000 operations		<b>Supply to sensors</b> <b>Emitter</b> Supply voltage (open loop) Current  Output resistance <b>Receiver</b> Supply voltage (open loop) Short-circuit current Input resistance	Pins 5 & 7 15 V square wave < 450 mA, short circuit protected 10 $\Omega$ Pins 6 & 8 5 VDC 10 mA 470 $\Omega$
<b>Transistor output data</b> Output current (I <sub>e</sub> )  Voltage drop (U <sub>d</sub> )	< 100 mA @ 10-40 VDC (max. load capacity 100 nF) < 2,5 VDC @ 100 mA			
<b>Output function</b> Relay Transistor	Make or break on DIP-switch SPDT NPN / PNP, 100 mA, 10-40 VDC			



## Specifications

<b>Emitter power</b> Power	Settings on DIP switch no 4, 50 % or 100 % range	<b>Response time</b> OFF-ON ( $t_{ON}$ ) ON-OFF ( $t_{OFF}$ )	0.1 – 10 s 0.1 – 10 s
<b>Sensitivity adjustment</b> Manual Automatic (Auto LED ON)	240° potentiometer Potentiometer settings fully counter clockwise	<b>Environment</b> Overvoltage category Degree of protection Pollution degree	III (IEC 60664) IP 20 /IEC 60529, 60947-1) 3 (IEC 60664/60664A, 60947-1)
<b>Max sensing distance</b>	Maximum range indicated on photoelectric switch data- sheets in 100 % settings	<b>Temperature</b> Operating Storage	-20° to +50°C (-4° to +122°F) -50° to +85°C (-58° to +185°F)
<b>Rated insulation voltage (U)</b>	250 VAC	<b>Housing material</b>	NORYL SE1, light grey
<b>Dielectric voltage</b>	>2.0 KVAC (rms) (contacts / electronics)	<b>Weight</b> AC supply AC/DC supply	200 g 125 g
<b>Rated impulse withstand volt.</b>	4 kV (1.2/50 $\mu$ S) (contacts / electronics) (IEC 664)	<b>Approvals</b>	UL508, UL325*, CSA
<b>Operating frequency (f)</b> Light / Dark ratio 1:1 Relay output Transistor output	5 Hz min delay 5 Hz min delay	<b>CE marking</b>	EN12445, EN12453**, EN12978

\* Must be approved in the final door installation

\*\* EN12453 (apply only when using Carlo Gavazzi MOF sensors with 2 and 5 degree optical angle)

## Specifications

### Diagnostic

If a fault occurs on either the emitter or receiver the Alarm LED and output will turn ON.

### Receiver fault

During normal operation the receiver is monitored for faults.

If the wires are short-circuited the "Code A, Yellow LED" flashes at a rate of 2 Hz.

If the wires are broken the "Code A, Yellow LED" flashes at a rate of 4 Hz.

### Emitter fault

During normal operation the emitter is monitored for faults.

If the wires are short-circuited the "Code B, Green LED" flashes at a rate of 2 Hz.

If the wires are broken the "Code B, Green LED" flashes at a rate of 4 Hz.

### Alignment

If the alignment DIP switch is set the Yellow Signal LED Flashes according to the signal quality.

Low frequency means weak signal.

Steady indication means maximum signal. On long distance it is not possible to get a steady signal but the alignment is optimal when the led flashes with the highest frequency.

On short distance the sensitivity can be reduced using the potentiometer and then get better readings in the alignment LED.

The ALARM output will follow the Signal LED in alignment mode, so a Sensor tester (optional) can be connected to serve as a remote indication during alignment of the sensors.

**NB!** In alignment mode the output is off.

### Code A or B

When two sensor pairs are mounted close to each other it is recommended to select one set to Code A and the

other to Code B to minimize crosstalk.

### Dirt reserve


For optimal detection excess gain settings can be selected using the Level Low/High DIP switch:

- High: Allows high dirt build-up.
- Low: Allows detection of semi-transparent objects.


### Power settings

To avoid a too strong emitter the power can be reduced to 50% reducing the max distance to 25%


## Wiring Diagram

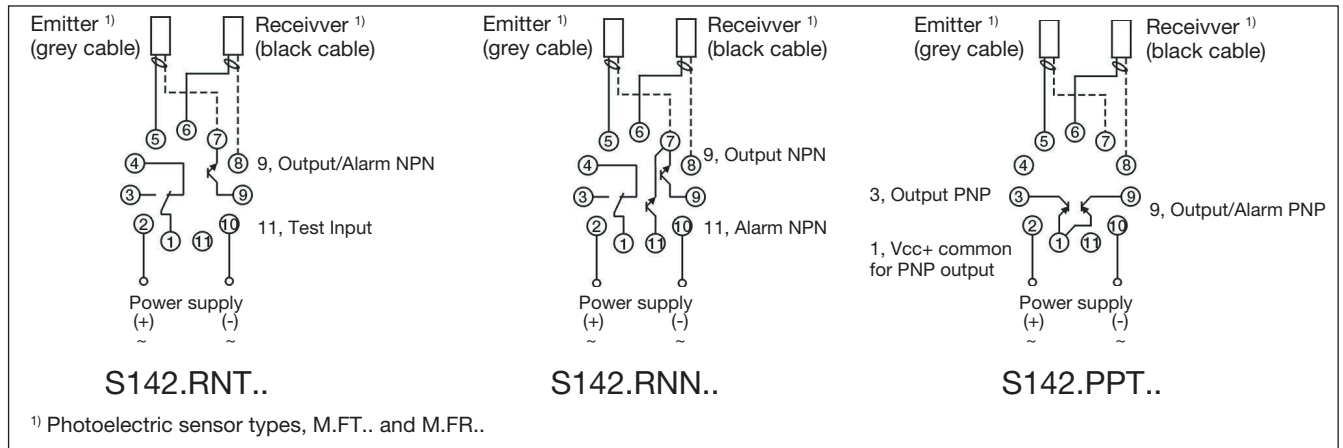

## Operation Diagram

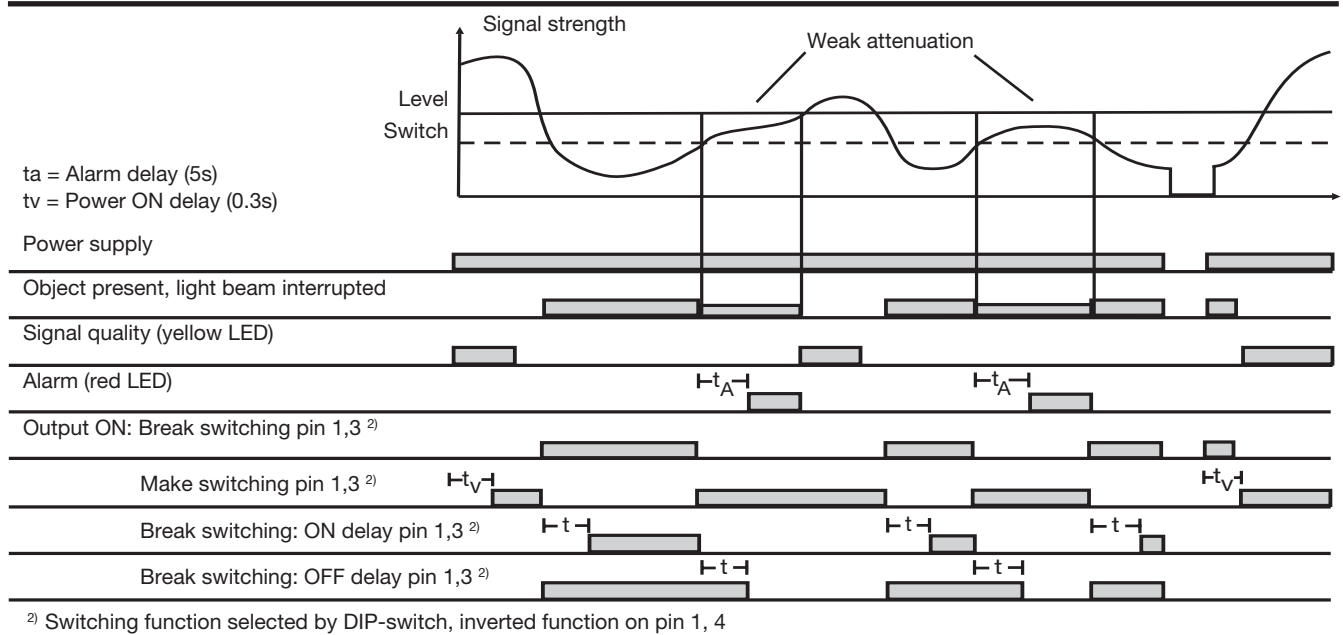

## Dimensions

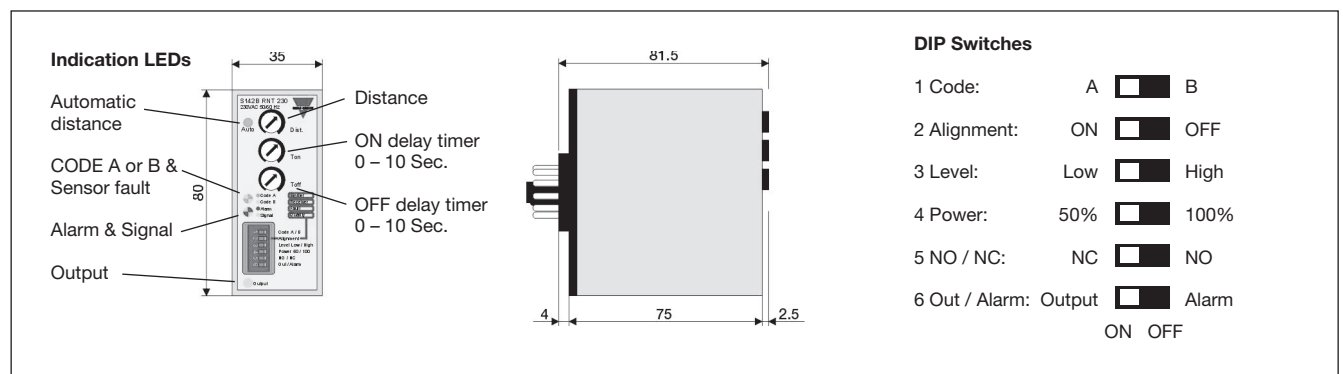



## Connection to sensortester

Connection to sensortester ST-03 for alignment

	Sensortester		
	-	Signal	+
RNT Pin no.	10	9	
RNN Pin no.	10	11	
PPT Pin no.		9	2

## Accessories

- 11 pole circular socket ZPD11
- Holding down spring HF
- Mounting rack SM13
- Front panel mounting bezel FRS2

## Delivery Contents

- Amplifier
- **Packaging:** Carton box

## Installation of industrial doors in compliance with the UL325 standard

### Connections

- 1) Connect the supply wires to the amplifier (for DC systems: + on terminal 2, - on terminal 10).
- 2) Make sure that the power is within the specified tolerances and employed as required by the local codes.

### Mounting

- 1) When installing the sensors, make sure that the maximum range is not exceeded and - if 2 separate systems are mounted close to each other - place the sensors so cross-talk is avoided.
- 2) To protect the receiver and the transmitter against damage, proper fittings must be used in the installation.
- 3) The amplifier must be mounted in an appropriate enclosure to protect it against mechanical as well as electrical damage and fire.
- 4) Do not apply power to the amplifier before the sensors are connected.
- 5) Connect the receiver and the emitter to the dedicated terminals.

- 6) Apply power to the amplifier.
- 7) The yellow LED's for the output should be ON (N.O.), OFF (N.C.) with no object present.  
*Note: For systems with test input, be sure that the Emitter is enabled.*
- 8) Interrupt the light beam and make sure that the yellow LED turns OFF (N.O), turns ON (N.C.).

For each door cycle:

The connected door controller must verify that the sensors operate properly, by testing the sensor function using the test input in at least one of the doors' end position.

### CAUTION

Not for use and mounting as a separate accessory. Only for incorporation by a professional inside a door, drapery, gate, louver or window operator or system after evaluation of the combination (assembly) has shown compliance with the applicable standards.

# Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

[Carlo Gavazzi:](#)

[S142BRNN115](#) [S142BRNN924](#)