# Thermistor motor protection relay CM-MSS.41

The thermistor motor protection relay CM-MSS.41 monitors the winding temperature of motors and protects them from overheating, overload and insufficient cooling.

The device is available with two different terminal versions. You can choose between the proven screw connection technology (double-chamber cage connection terminals) and the completely tool-free Easy Connect Technology (push-in terminals).



## **Characteristics**

- 1 measuring circuit
- Test / Reset button
- Auto, manual or remote reset configurable
- Short-circuit monitoring of the sensor circuit, configurable
- Dynamic interrupted wire detection
- Non-volatile fault storage, configurable
- Easy configuration via DIP switches
- LEDs to distinguish between different failure causes
- Overvoltage protected supply and measuring inputs
- Increased interference immunity acc. to EN 62061 with evaluation criterion "Fail-Safe"
- According to the latest version of the product standard IEC 60947-8
- Screw connection technology or Easy Connect Technology available
- Housing material for highest fire protection classification UL 94 V-0
- Tool-free mounting on DIN rail as well as demounting
- 22.5 mm (0.89 in) width

## Approvals

- UL 508, CAN/CSA C22.2 No.14
- 🖲 GL
- EAC EAC
- CB CB scheme
- 000 m
- ⟨€x⟩ ATEX

## Marks

- CE CE
- 💩 RCM

Туре	Rated control supply voltage	Output contacts	Connection technology	Order code
CM-MSS.41P	24-240 V AC/DC	2 c/o (SPDT) contacts	Push-in terminals	1SVR740712R1200
CM-MSS.41S			Screw terminals	1SVR730712R1200




## Order data

## **Connection technology**

# Maintenance free Easy Connect Technology with push-in terminals

Type designation CM-xxS.yyP

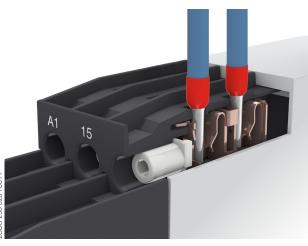


## Push-in terminals

- Tool-free connection of rigid and flexible wires with wire end ferrule according to DIN 46228-1-A, DIN 46228-4-E
- Wire size: 2 x 0.5-1.5 mm<sup>2</sup>, (2 x 20 16 AWG) - Easy connection of flexible wires without wire end
- ferrule by opening the terminals
- No retightening necessary
- One operation lever for opening both connection terminals
- For triggering the lever and disconnecting of wires you can use the same tool (Screwdriver according to DIN ISO 2380-1 Form A 0.8 x 4 mm (0.0315 x 0.157 in), DIN ISO 8764-1 PZ1 Ø 4.5 mm (0.177 in))
- Constant spring force on terminal point independent of the applied wire type, wire size or ambient conditions (e. g. vibrations or temperature changes)
- Opening for testing the electrical contacting
- Gas-tight

Approved screw connection technology with double-chamber cage connection terminals

Type designation CM-xxS.yyS

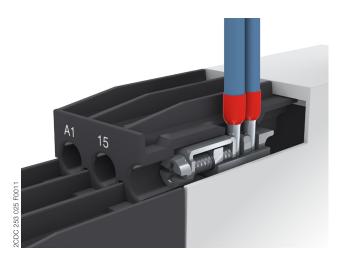


Double-chamber cage connection terminals

- Terminal spaces for different wire sizes: fine-strand with/without wire end ferrule:
  1 x 0.5-2.5 mm<sup>2</sup> (2 x 20 - 14 AWG),
  2 x 0.5-1.5 mm<sup>2</sup> (2 x 20 - 16 AWG)
  rigid:
  1 x 0.5-4 mm<sup>2</sup> (1 x 20 - 12 AWG),
  2 x 0.5-2.5 mm<sup>2</sup> (2 x 20 - 14 AWG)
- One screw for opening and closing of both cages
- Pozidrive screws for pan- or crosshead screwdrivers according to DIN ISO 2380-1 Form A 0.8 x 4 mm (0.0315 x 0.157 in), DIN ISO 8764-1 PZ1 Ø 4.5 mm (0.177 in)

Both the Easy Connect Technology with push-in terminals and screw connection technology with double-chamber cage connection terminals have the same connection geometry as well as terminal position.

## **Functions**

## Operating controls

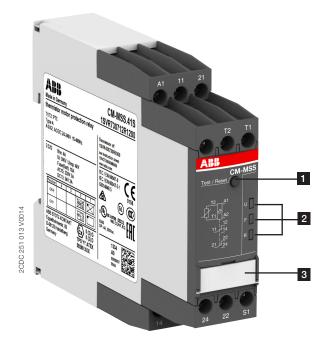



Reset - only possible if measured value < switch-on resistance

## 2 Indication of operational states with LEDs

U: green LED - Status indication of control supply voltage

F: red LED - Fault message

R: yellow LED - Status indication of the output relay

3 DIP switches (see DIP switch functions)

## Application / Monitoring function

The thermistor motor protection relay CM-MSS monitors the winding temperature and thus protects the motor from overheating, overload and insufficient cooling in accordance to the product standard IEC 60947-8, control units for built-in thermal protection (PTC) for rotating electrical machines.

## **Operating mode**

The thermistor motor protection relay CM-MSS.41 is used to monitor the temperature of motors or generators equipped with PTC resistor sensors type A. The sensors are built-in into the motor windings, measuring the motor heating. In case of an increase of the temperature in the motor, the resistance of the PTC sensors will increase as well. If the motor heats-up excessively (>2.83 k $\Omega$ ) the output relays de-energize and the corresponding LED displays the overtemperature. A short circuit and an interrupted wire within the sensor circuit can also be detected. A reset is only possible after cooling down of the motor (<1.1 k $\Omega$ ) or after a wire interruption or a short circuit within the sensor circuit has been removed. A reset after tripping can be done manually with the Test / Reset button, externally with a push button between S1 and T2, or automatically by jumpering S1 and T2.

By pressing the front-face combined Test / Reset button a system test routine is executed.

## Short-circuit detection **D**

If a short circuit is detected between the two lines of a sensor circuit, the output relays de-energize and the LEDs will display the specific error code.

## Dynamic interrupted wire detection

During the operation the device is permanently monitoring the measuring circuit. If the resistance in the measuring circuit rises, the device distinguishes if there is an overtemperature or an interrupted wire. Then the output relays de-energize.

## Test function

The test function is only possible when there is no fault. By pressing the front-face combined Test / Reset button or by jumpering S1-T2 a system test routine is executed. If S1-T2 are jumpered for the automatic reset, the test function can only be executed by pressing the Test / Reset button.

After starting the test routine the output relays de-energize. They remain de-energized until control input S1-T2 is closed or a reset is executed.


## Fault storage **E**, reset function

The fault storage is designed as non-volatile (remanent). This means that after switch-off and return of the control supply voltage the device returns to the state it was prior to the switch-off. If prior to the interruption of control supply voltage there was no fault, the device restarts automatically after re-applying control supply voltage.


If there was a fault prior to the interruption, reset can be made manually by the Test / Reset button or externally by remote reset between S1-T2.

With deactivated fault storage reset can be made manually by the Test / Reset button, automatically by jumpering S1-T2 or externally by remote reset between S1-T2.

Depending on the configuration of DIP switch 1, there are several possibilities of resetting the device, as shown in the picture.



## **Electrical connection**



A1 – A2 11 – 12/14 21 – 22/24 S1 – T2 (jumpered) T1 – T2 Control supply voltage 1st c/o (SPDT) contact 2nd c/o (SPDT) contact Automatic reset Measuring circuit

Connection diagram CM-MSS.41

## **DIP** switches

	DIP switch 4	DIP switch 3	DIP switch 2	DIP switch 1
ON				
			Short-circuit detection de-activated	Non-volatile fault storage de-activated
OFF (default)				
(dordant)			Short-circuit detection activated	Non-volatile fault storage activated


## Indication of operational states

## LEDs, status information and fault messages


Operational State	U: LED green	F: LED red	R: LED yellow
Absence of control supply voltage	OFF	OFF	OFF
No fault		OFF	
Short circuit			OFF
Interrupted wire			OFF
Overtemperature		<u>г</u>	OFF
Test function	IIII	OFF	OFF
Fault rectified but not confirmed	[	1)	MM
Change of configuration not confirmed		OFF	MM
Control supply voltage not within the tolerance range			OFF
Internal fault 2)	OFF		ЛЛ
Internal fault 2)	IIII	MM	MM

Depending on the fault
 Restart the device. If after restart the same fault is indicated, replace the device

## **Function diagrams**

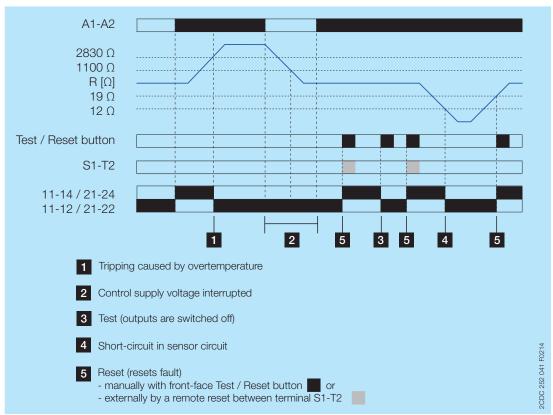


Manual or remote reset (= non-volatile fault storage)

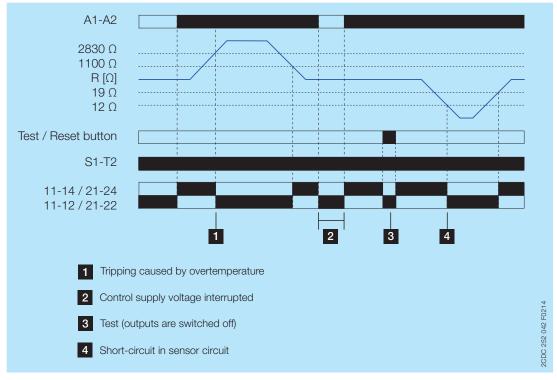

Auto reset (= no fault storage)

## Example of application

## Circuit diagram

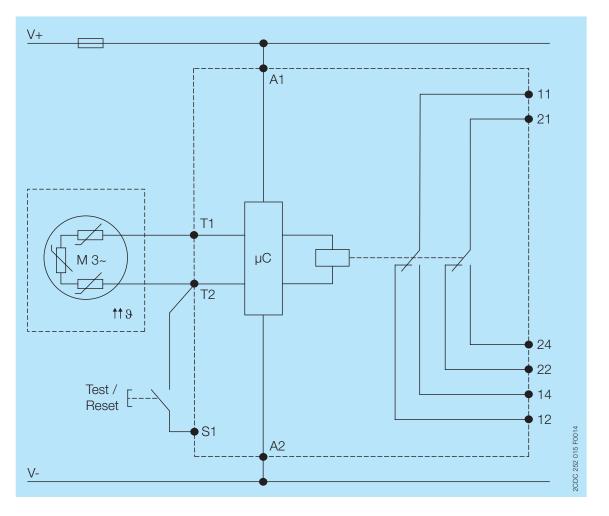

## **Technical data**

Data at  $T_a$  = 25 °C and rated values, unless otherwise indicated

## Input circuit

Supply circuit		
Rated control supply voltage $U_s$	A1-A2	24-240 V AC/DC
Rated control supply voltage $\mathrm{U}_{\mathrm{s}}$ tolerance		-15+10 %
Rated frequency		15-400 Hz
Typical current / power consumption	24 V AC/DC	33 mA / 0.55 VA
	220-240 V AC	11 mA / 1.6 VA
Electrical insulation between supply circuit and		yes
Power failure buffering time		20 ms
Measuring circuit / Sensor circuit		T1-T2
Number of sensor circuits		1
Sensor type		PTC type A (DIN/EN 44081, DIN/EN 44082)
Max. total resistance of sensors connected in	series, cold state	< 750 Ω
Overtemperature monitoring	switch-off resistance (relays de-energize)	2.83 k $\Omega$ $\pm$ 1%
	switch-on resistance (relays energize)	1.1 k $\Omega$ ± 1%
Short-circuit detection		configurable
	switch-off resistance (relays de-energize)	<12 Ω
	switch-on resistance (relays energize)	>19 Ω
Interrupted wire detection	switch-off resistance (relays de-energize)	dynamic
	switch-on resistance (relays energize)	not available
Non-volatile fault storage		configurable
Test function		yes
Maximum voltage in sensor circuit	1.33 kOhm	2.5 V
	4 kOhm	3.7 V
	∞ kOhm	5.5 V
Maximum current in sensor circuit		3.7 mA
Maximum sensor cable length		2 x 100 m at 0.75 mm², 2 x 400 m at 2.5 mm
Accuracy within the rated control supply volta	ge tolerance	0.50 %
Accuracy within the temperature range		0.01 %/K
Repeat accuracy (constant parameters)		on request
Reaction time of the safety function		<100 ms
Hardware fault tolerance (HFT)		0
Control circuit		S1 - T2
Control function	manual reset	yes
	auto reset	adjustable
	remote reset	adjustable
Maximum no-load voltage (S1-T2 open)		5.5 V
Max. current (S1-T2 jumpered)		0.6 mA
		2 x 100 m at 0.75 mm <sup>2</sup> , 2 x 400 m at 2.5 mm

Indication of operational states		
Control supply voltage	U	LED green
Relay status	R	LED yellow
Fault message	F	See 'LEDs, status information and fault
		messages' on page 5
Operating controls		
Test / Reset		front-face button
Configuration of		non-volatile fault storage
		short-circuit detection

## Output circuit

Kind of output	11-12/14	relay, 1st c/o (SPDT) contact
	21-22/24	relay, 2nd c/o (SPDT) contact
Operating principle		closed-circuit principle
ontact material		AgNi alloy, Cd free
Rated operational voltage U <sub>e</sub> (IEC/EN 60947-1)		250 V AC
Minimum switching voltage / Minimum switching current		24 V / 10 mA
Maximum switching voltage / Maximum switching current		See 'Load limit curves' on page 12
Rated operating current I <sub>e</sub> (IEC/EN 60947-5-1)	AC-12 (resistive) at 230 V	4 A
	AC-15 (inductive) at 230 V	3 A
	DC-12 (resistive) at 24 V	4 A
	DC-13 (inductive) at 24 V	2 A
AC Rating (UL 508) utilization cate	egory (Control Circuit Rating Code)	В 300
1	naximum rated operational voltage	250 V AC
maximum c	ontinuous thermal current at B 300	4 A
maximum making,	breaking apparent power at B 300	3600/360 VA
Mechanical lifetime		30 x 10 <sup>6</sup> switching cycles
Electrical lifetime	at AC12, 230 V AC, 4 A	0.1 x 10 <sup>6</sup> switching cycles
Maximum fuse rating to achieve short-circuit protection	n/c contact	10 A fast-acting
	n/o contact	10 A fast-acting

## General data

MTBF		on request	
Duty time		100 %	
Dimensions (W x H x D)	product dimensions	22.5 x 85.6 x 103.7 m	nm (0.89 x 3.37 x 4.08 in)
	packaging dimensions	97 x 109 x 30 mm (3.8	82 x 4.29 x 1.18 in)
Weight		Screw connection technology	Easy Connect Technology (push-in)
	net weight	0.141 kg	0.130 kg
	gross weight	0.167 kg	0.157 kg
Mounting		DIN rail (IEC/EN 60715), snap-on mounting without any tool	
Mounting position		any	•
Minimum distance to other units	vertical	10 mm (0.394 in) if sw	vitching current > 2 A
	horizontal	10 mm (0.394 in) if switching current > 2 A	
Material of housing		UL 94 V-0	•
Degree of protection	housing	IP50	
	terminals	IP20	

## Electrical connection

		Screw connection technology	Easy Connect Technology (push-in)
Wire size	fine-strand with(out)	1 x 0.5-2.5 mm <sup>2</sup>	2 x 0.5-1.5 mm <sup>2</sup>
	wire end ferrule	(1 x 20-14 AWG)	(2 x 20-16 AWG)
		2 x 0.5-1.5 mm <sup>2</sup>	
		(2 x 20-16 AWG)	
	rigid	1 x 0.5-4 mm <sup>2</sup>	2 x 0.5-1.5 mm <sup>2</sup>
		(1 x 20-12 AWG)	(2 x 20-16 AWG)
		2 x 0.5-2.5 mm <sup>2</sup>	
		(2 x 20-14 AWG)	
Stripping length		8 mm (0.32 in)	
Tightening torque		0.6-0.8 Nm	-
		(5.31-7.08 lb.in)	
Wire end ferrule		according to	
		DIN 46228-1-A,	
		DIN 46228-4-E	

## Environmental data

Ambient temperature ranges		-25 °C+60 °C
	storage	-40 °C+85 °C
Damp heat, cyclic (IEC/EN 60068-2-30)		6 x 24 h cycle, 55 °C, 95 % RH
Climatic category (IEC/EN 60721-3-3)	•	3K5 (no condensation, no ice formation)
Vibration, sinusoidal (IEC/EN 60255-21-1)		Class 2
Shock (IEC/EN 60255-21-2)		Class 2

## Isolation data

Rated insulation voltage U <sub>i</sub>	Supply circuit / Measuring circuit <sup>1)</sup>	300 V AC
(IEC/EN 60947-1, IEC/EN 60664-1)	Supply circuit / Output circuits	300 V AC
	Measuring circuit <sup>1)</sup> / Output circuits	300 V AC
	Output circuit 1 / Output circuit 2	300 V AC
Rated impulse withstand voltage Uimp	Supply circuit / Measuring circuit <sup>1)</sup>	4 kV / 6 kV
(IEC/EN 60947-1, IEC/EN 60664-1)	Supply circuit / Output circuits	4 kV / 6 kV
	Measuring circuit <sup>1)</sup> / Output circuits	4 kV / 6 kV
	Output circuit 1 / Output circuit 2	4 kV
Basic insulation (IEC/EN 60664-1)	Supply circuit / Measuring circuit <sup>1)</sup>	600 V AC
	Supply circuit / Output circuits	600 V AC
	Measuring circuit <sup>1)</sup> / Output circuits	600 V AC
	Output circuit 1 / Output circuit 2	300 V AC
Test voltage, routine test	Supply circuit / Measuring circuit <sup>1)</sup>	2.5 kV, 50 Hz, 1 min.
(IEC/EN 60255-27, IEC/EN 61010-1)	Supply circuit / Output circuits	2.5 kV, 50 Hz, 1 min.
	Measuring circuit <sup>1)</sup> / Output circuits	2.5 kV, 50 Hz, 1 min.
Test voltage, type test	Supply circuit / Measuring circuit <sup>1)</sup>	6 kV / 1.2 - 50 μs
(IEC/EN 60255-27)	Supply circuit / Output circuits	6 kV / 1.2 - 50 μs
	Measuring circuit <sup>1)</sup> / Output circuits	6 kV / 1.2 - 50 μs
	Output circuit 1 / Output circuit 2	6 kV / 1.2 - 50 μs
Protective separation	Supply circuit / Measuring circuit <sup>1)</sup>	yes, up to 300 V
(IEC/EN 61140, IEC/EN 50178)	Supply circuit / Output circuits	yes
	Measuring circuit <sup>1)</sup> / Output circuits	yes
	Output circuit 1 / Output circuit 2	no
Pollution degree (IEC/EN 60664-1)		3
Overvoltage category (IEC/EN 60664-1)		111

<sup>1)</sup> Potential of measuring circuit = Potential of control circuit

## Standards


Product standard	IEC/EN 60255-1; IEC/EN 60947-8
Low Voltage Directive	2006/95/EC
EMC directive	2004/108/EC
ATEX directive	94/9/EC
RoHS directive	2011/65/EC

## Electromagnetic compatibility


	ence immunity to		IEC/EN 61000-6-1, IEC/EN 61000-6-2
	electrostatic discharge	IEC/EN 61000-4-2	Level 3, 6 kV contact discharge, 8 kV air discharge
	radiated, radio-frequency, electromagnetic field	IEC/EN 61000-4-3	Level 3, 10 V/m (1 GHz), 3 V/m (2 GHz), 1 V/n (2.7 GHz)
	electrical fast transient / burst	IEC/EN 61000-4-4	Level 3, 2 kV / 5 kHz
	surge	IEC/EN 61000-4-5	Level 3, Installation class 3, supply circuit and measuring circuit 1 kV L-L, 2 kV L-N
	conducted disturbances, induced by radio-frequency fields	IEC/EN 61000-4-6	Level 3, 0.15-80 MHz, 10 V, 80 % AM (1kHz)
	voltage dips, short interruptions and voltage variations	IEC/EN 61000-4-11	Class 3
	harmonics and interharmonics	IEC/EN 61000-4-13	Class 3
Additio	nal interference immunity according to product standard EN	60255-1	
(referer	ce on EN 60255-26_2011)		
	radiated, radio-frequency, electromagnetic field	IEC/EN 61000-4-3	10 V/m (80 MHz - 3 GHz)
	conducted disturbances, induced by radio-frequency fields	IEC/EN 61000-4-6	10 V at stated frequencies
	damped oscillatory waves	IEC/EN 61000-4-18	Signal lines, symmetric coupling:
			1 kV peak voltage
			Power supply, asymmetric coupling:
			2.5 kV peak voltage,
	ed interference immunity acc. to EN 62061 for safety with th afe" against	e evaluation criterion	2.5 kV peak voltage, IEC/EN 61000-6-1, IEC/EN 61000-6-2
		e evaluation criterion IEC/EN 61000-4-2	
	afe" against		IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air
	afe" against electrostatic discharge	IEC/EN 61000-4-2	IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air discharge Level 3, 20 V/m (1 GHz), 6 V/m (2 GHz), 3 V/n
	afe" against electrostatic discharge radiated, radio-frequency, electromagnetic field	IEC/EN 61000-4-2 IEC/EN 61000-4-3	IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air discharge Level 3, 20 V/m (1 GHz), 6 V/m (2 GHz), 3 V/n (2.7 GHz)
	afe" against electrostatic discharge radiated, radio-frequency, electromagnetic field electrical fast transient / burst	IEC/EN 61000-4-2 IEC/EN 61000-4-3 IEC/EN 61000-4-4	IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air discharge Level 3, 20 V/m (1 GHz), 6 V/m (2 GHz), 3 V/n (2.7 GHz) Level 3, 4 kV / 5 kHz Level 3, Installation class 3, supply circuit and
	afe" against electrostatic discharge radiated, radio-frequency, electromagnetic field electrical fast transient / burst surge conducted disturbances, induced by radio-frequency	IEC/EN 61000-4-2 IEC/EN 61000-4-3 IEC/EN 61000-4-4 IEC/EN 61000-4-5	IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air discharge Level 3, 20 V/m (1 GHz), 6 V/m (2 GHz), 3 V/n (2.7 GHz) Level 3, 4 kV / 5 kHz Level 3, Installation class 3, supply circuit and measuring circuit 2 kV L-L, 4 kV L-N
	afe" against electrostatic discharge radiated, radio-frequency, electromagnetic field electrical fast transient / burst surge conducted disturbances, induced by radio-frequency fields	IEC/EN 61000-4-2 IEC/EN 61000-4-3 IEC/EN 61000-4-4 IEC/EN 61000-4-5 IEC/EN 61000-4-6	IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air discharge Level 3, 20 V/m (1 GHz), 6 V/m (2 GHz), 3 V/n (2.7 GHz) Level 3, 4 kV / 5 kHz Level 3, Installation class 3, supply circuit and measuring circuit 2 kV L-L, 4 kV L-N Level 3, 10 V
'Fail-Sa	against         electrostatic discharge         radiated, radio-frequency, electromagnetic field         electrical fast transient / burst         surge         conducted disturbances, induced by radio-frequency         fields         voltage dips, short interruptions and voltage variations	IEC/EN 61000-4-2 IEC/EN 61000-4-3 IEC/EN 61000-4-4 IEC/EN 61000-4-5 IEC/EN 61000-4-6 IEC/EN 61000-4-11	IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air discharge Level 3, 20 V/m (1 GHz), 6 V/m (2 GHz), 3 V/n (2.7 GHz) Level 3, 4 kV / 5 kHz Level 3, Installation class 3, supply circuit and measuring circuit 2 kV L-L, 4 kV L-N Level 3, 10 V Class 3
'Fail-Sa	afe" against electrostatic discharge radiated, radio-frequency, electromagnetic field electrical fast transient / burst surge conducted disturbances, induced by radio-frequency fields voltage dips, short interruptions and voltage variations harmonics and interharmonics	IEC/EN 61000-4-2 IEC/EN 61000-4-3 IEC/EN 61000-4-4 IEC/EN 61000-4-5 IEC/EN 61000-4-6 IEC/EN 61000-4-11	IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air discharge Level 3, 20 V/m (1 GHz), 6 V/m (2 GHz), 3 V/n (2.7 GHz) Level 3, 4 kV / 5 kHz Level 3, Installation class 3, supply circuit and measuring circuit 2 kV L-L, 4 kV L-N Level 3, 10 V Class 3 Class 3
"Fail-Sa	afe" against electrostatic discharge radiated, radio-frequency, electromagnetic field electrical fast transient / burst surge conducted disturbances, induced by radio-frequency fields voltage dips, short interruptions and voltage variations harmonics and interharmonics ence emissions	IEC/EN 61000-4-2 IEC/EN 61000-4-3 IEC/EN 61000-4-4 IEC/EN 61000-4-5 IEC/EN 61000-4-6 IEC/EN 61000-4-11 IEC/EN 61000-4-13	IEC/EN 61000-6-1, IEC/EN 61000-6-2 Level 3, 6 kV contact discharge, 8 kV air discharge Level 3, 20 V/m (1 GHz), 6 V/m (2 GHz), 3 V/n (2.7 GHz) Level 3, 4 kV / 5 kHz Level 3, Installation class 3, supply circuit and measuring circuit 2 kV L-L, 4 kV L-N Level 3, 10 V Class 3 Class 3 IEC/EN 61000-6-3, IEC/EN 61000-6-4

## **Technical diagrams**


## Load limit curves

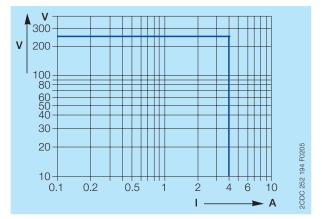


AC load (resistive)

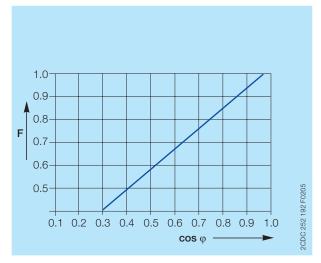

Reduction factor F for inductive AC load

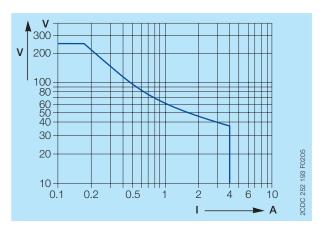


DC load (resistive)

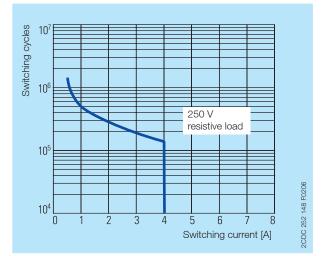

Contact life time / number of operations N 220 V 50 Hz 1 AC, 360 operations/h


## **Dimensions**

## in **mm** and inches

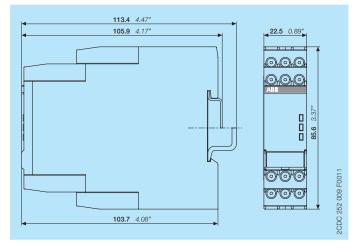


Accessories


in mm and inches



ADP.01 - Adapter for screw mounting



MAR.12 - Marker label for devices with DIP switches



COV.11 - Sealable transparent cover

#### **Further documentation**

Document title	Document type	Document number
Electronic products and relays	Technical catalogue	2CDC 110 004 C02xx
Operating and installation instructions CM-MSS.41	Instruction manual	1SVC 730 650 M0000

You can find the documentation on the internet at

http://new.abb.com/low-voltage/products/epr/monitors/thermistor-motor-protection-relays

## CAD system files

You can find the CAD files for CAD systems at

http://abb-control-products.partcommunity.com/portal/portal/abb-control-products

-> Low Voltage Products & Systems -> Control Products -> Electronic Relays and Controls

-> Thermistor Motor Protection Relays.

## Contact us

ABB STOTZ-KONTAKT GmbH

P. O. Box 10 16 80 69006 Heidelberg, Germany Phone: +49 (0) 6221 7 01-0 Fax: +49 (0) 6221 7 01-13 25 E-mail: info.desto@de.abb.com

You can find the address of your local sales organisation on the ABB home page http://www.abb.com/contacts -> Low Voltage Products and Systems

#### Note:

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB AG does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB AG.

Copyright© 2014 ABB All rights reserved