

# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

Please be informed that the data shown in this PDF document is generated from our online catalog. Please find the complete data in the user documentation. Our general terms of use for downloads are valid.



Set consisting of a 4-way signal conditioner with screw connection technology and a Rogowski coil 300 mm in length/95 mm in diameter for AC current measurement on busbars and power lines.

The signal conditioner outputs 8 different standard signals on the output side and has one switching output.

## Commercial data

Item number	2906231
Packing unit	1 pc
Minimum order quantity	1 pc
Sales key	C444
Product key	CK4A12
Catalog page	Page 223 (C-5-2019)
GTIN	4055626048147
Weight per piece (including packing)	420.8 g
Weight per piece (excluding packing)	374 g
Customs tariff number	85437090
Country of origin	DE

## Technical data

### Product properties

Product type	Current transformer
--------------	---------------------

### Insulation characteristics

Overvoltage category	II
Pollution degree	2

### Electrical properties

Electrical isolation	Reinforced insulation in accordance with IEC 61010-1
Typical measuring error	< 1 %
Protective circuit	Surge protection; 33 V suppressor diode
Step response (0–99%)	110 ms
Rated insulation voltage	300 V

### Measuring coil

Conductor structure signal line	2x 0.22 mm (Signal (tinned))
	1x 0.22 mm (Shielding (tinned))
Insulation	double insulation
Rated insulation voltage	1000 V AC (rms CAT III)
	600 V AC (rms CAT IV)
Test voltage	10.45 kV DC (60 s)
Basic accuracy	<± 0.2 %

### Measuring transducers

Maximum transmission error	≤ 0.5 % (From the range end value)
Frequency range	16 Hz ... 1000 Hz
Test voltage	3 kV (50 Hz, 1 min.)

### General

Can be calibrated	no
Class	1
Accuracy class	1
Converter type	Rogowski coil and 4-way signal conditioner

### Supply: Measuring transducers

Nominal supply voltage	24 V DC
Nominal supply voltage range	9.6 V DC ... 30 V DC
Power consumption	≤ 1 W (at I <sub>OUT</sub> = 20 mA, 9.6 V DC, 600 Ω load)

## Input data

### Frequency

Designation	Measuring coil
Frequency measuring range	40 Hz ... 20000 Hz

# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

Position error	<± 0.1 % (typical)
Linearity error	< 0.1 %

## Signal

Input signal (at 50 Hz)	100 mV (1000 A)
Curve type	Sine
Input impedance	> 100 kΩ

## Current transformers

Configurable/programmable	Via DIP switches
Rated frequency: Standard converter	40 Hz ... 20000 Hz
Primary rated current $I_{pn}$	0 A AC ... 100 A AC
	0 A AC ... 250 A AC
	0 A AC ... 400 A AC
	0 A AC ... 630 A AC
	0 A AC ... 1000 A AC
	0 A AC ... 1500 A AC
	0 A AC ... 2000 A AC
	0 A AC ... 4000 A AC
Can be calibrated	no
Class	1
Accuracy class	1
Converter type	Rogowski coil and 4-way signal conditioner

## Output data

### Switching: Transistor

Number of outputs	1
Contact switching type	1 N/O contact
Minimum switching voltage	1 V
Maximum switching voltage	30 V DC
Min. switching current	100 μA
Max. switching current	100 mA (at 30 V)

### Signal

Designation	Measuring coil
Output signal (at 50 Hz)	100 mV (no load, at 1,000 A)
Output voltage (in no-load operation)	$V_{OUT} = M \cdot dI/dt$
Output voltage (sinusoidal, in no-load operation)	100 mV ( $V_{OUT} = 2 \cdot \pi \cdot M \cdot f \cdot I$ (M = 0.318 μH; example: At 50 Hz; I = 1,000 A))
Accuracy class	1

### Signal

Designation	Measuring transducer
Configurable/programmable	Yes
Voltage output signal	0 V ... 10 V (via DIP switch)
	2 V ... 10 V (via DIP switch)

# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

	0 V ... 5 V (via DIP switch)
	1 V ... 5 V (via DIP switch)
	0 V ... 10.5 V (can be set via software)
Max. voltage output signal	≈  V
Current output signal	0 mA ... 20 mA (via DIP switch)
	4 mA ... 20 mA (via DIP switch)
	0 mA ... 10 mA (via DIP switch)
	2 mA ... 10 mA (via DIP switch)
	0 mA ... 21 mA (can be set via software)
Max. current output signal	24.6 mA
Load/output load voltage output	≥ 10 kΩ
Load/output load current output	≤ 600 Ω (20 mA)
Ripple	< 20 mV <sub>PP</sub>
	< 20 mV <sub>PP</sub>

## Connection data

### Measuring transducer side

Connection method	Screw connection
Stripping length	10 mm
Screw thread	M3
Conductor cross section rigid	0.2 mm <sup>2</sup> ... 1.5 mm <sup>2</sup>
Conductor cross section flexible	0.2 mm <sup>2</sup> ... 1.5 mm <sup>2</sup>
Conductor cross section AWG	26 ... 16
Tightening torque	0.5 Nm ... 0.6 Nm

## Dimensions

### Item dimensions

Width	6.2 mm
Height	110.5 mm
Depth	120.5 mm

### Measuring coil

Length	300 mm
Diameter	8.3 mm ±0.2 mm

### Measuring coil when installed

Diameter	95 mm
----------	-------

### Signal line

Length	3 m
Width	6.2 mm
Height	110.5 mm
Depth	120.5 mm

## Material specifications

# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

Coil material	Elastollan
Housing material	PC
	PBT

## Environmental and real-life conditions

### Ambient conditions

Measuring coil degree of protection	IP67 (not assessed by UL)
Measuring transducer degree of protection	IP20
Ambient temperature (operation)	-30 °C ... 80 °C (Measuring coil)
	-40 °C ... 70 °C (Measuring transducer)
Ambient temperature (storage/transport)	-40 °C ... 80 °C (Measuring coil)
	-40 °C ... 85 °C (Measuring transducer)
Altitude	< 2000 m
Permissible humidity (operation)	5 % ... 95 % (non-condensing)

## Approvals

### CE

Certificate	CE-compliant
-------------	--------------

### UKCA

Certificate	UKCA-compliant
-------------	----------------

### CMIM

Certificate	CMIM-compliant
-------------	----------------

### UL, USA/Canada

Identification	UL 61010 Recognized
Note	Measuring coil

### UL, USA/Canada

Identification	UL 508 Listed
Note	Measuring transducer

## EMC data

Noise immunity	EN 61000-6-2
Note	When being exposed to interference, there may be minimal deviations.
Electromagnetic compatibility	Conformance with EMC directive
Noise emission	EN 61000-6-4

## Standards and regulations

Electrical isolation	Reinforced insulation in accordance with IEC 61010-1
Standards/regulations	IEC 61010-1
	IEC 61010-2-032

## Mounting

# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

Mounting type	DIN rail mounting
---------------	-------------------

# PACT RCP-4000A-UIRO-D95 - Current transformer




2906231

<https://www.phoenixcontact.com/us/products/2906231>

## Drawings

Block diagram

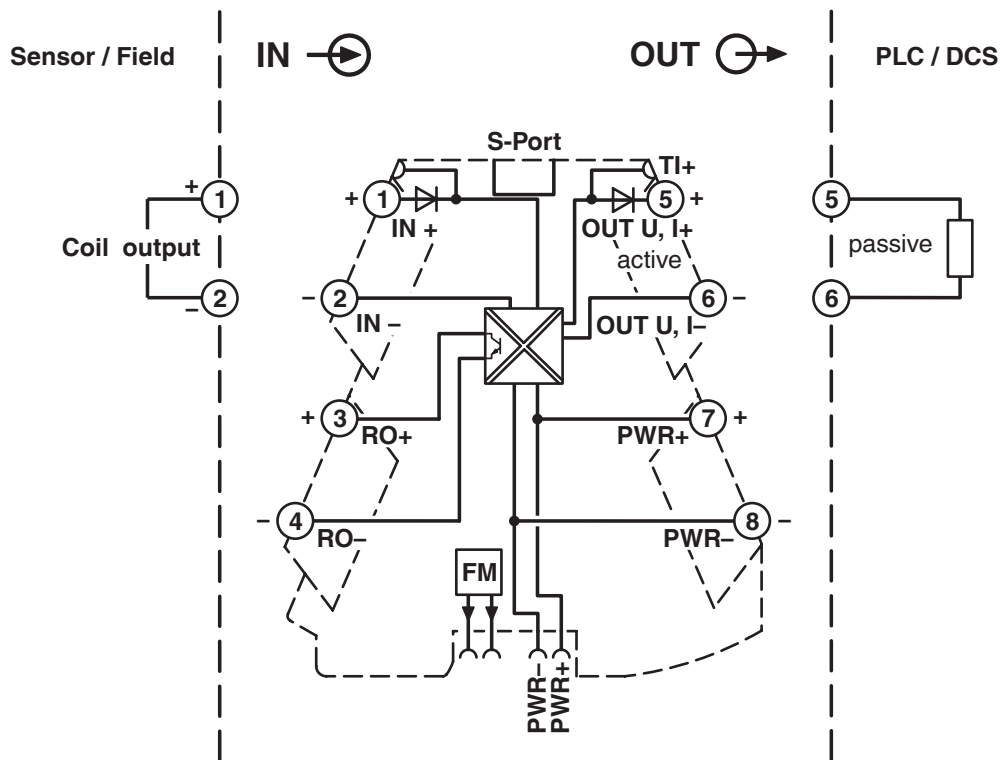

# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

## Approvals

To download certificates, visit the product detail page: <https://www.phoenixcontact.com/us/products/2906231>



**EAC**

Approval ID: RU\*DE\*08.B.01187/19



# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

## Classifications

### ECLASS

ECLASS-11.0	27210902
ECLASS-13.0	27210902
ECLASS-12.0	27210902

### ETIM

ETIM 9.0	EC002048
----------	----------

### UNSPSC

UNSPSC 21.0	39121000
-------------	----------

# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

## Environmental product compliance

REACH SVHC	Lead 7439-92-1
China RoHS	Environmentally Friendly Use Period = 50 years
	For information on hazardous substances, refer to the manufacturer's declaration available under "Downloads"

# PACT RCP-4000A-UIRO-D95 - Current transformer



2906231

<https://www.phoenixcontact.com/us/products/2906231>

## Accessories

### PACT RCP-CLAMP - Holder

2904895

<https://www.phoenixcontact.com/us/products/2904895>



The optional holding device ensures the Rogowski coil is securely seated on busbars with a thickness of 10 ... 15 mm. During installation, the coil housing is pushed onto the flange of the holding device and snaps in automatically.

---

### PACT RCP-CLAMP-5-10 - Holder

2907888

<https://www.phoenixcontact.com/us/products/2907888>



The optional holding device ensures the Rogowski coil is securely seated on busbars that are 5 ... 10 mm thick. During installation, the coil housing is pushed onto the flange of the holding device and snaps in automatically.

---

Phoenix Contact 2024 © - all rights reserved

<https://www.phoenixcontact.com>

Phoenix Contact USA  
586 Fulling Mill Road  
Middletown, PA 17057, United States  
(+717) 944-1300  
[info@phoenixcon.com](mailto:info@phoenixcon.com)