

HYDRAULIC SAFETY GROUP



BELGAQUA



CSTB

Compliant with standard EN 1487


SFR

stainless steel

The fruit of much work with plumbing contractors and manufacturers of electrical hot water storage heaters, the SFR will be of great interest to professionals and fully meet the most demanding expectations.

◆ SFR 3/4" STAINLESS STEEL for calcareous, hard and aggressive waters :

This top-of-the-range safety group features a stainless steel seat to prevent corrosion from impairing the valve seal. SFR STAINLESS STEEL is recommended especially where water is aggressive, hard or even calcareous.

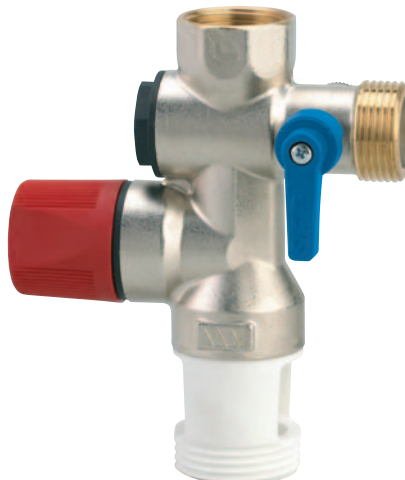

ref. 52570
SFR STAINLESS STEEL
Blue sticker

◆ APPLICATION



The hydraulic safety groups are used in domestic water systems to protect hot water storage heaters.

They combine different components with the following functions:

- Safety function to prevent the pressure of the water in the storage heaters reaching dangerous levels.

◆ ADVANTAGES

1. Fast filling rate of more than 4000 L/h under 1 bar.
2. Less head loss, greater convenience for users.
3. Valve knob designed for excellent grip.
4. New valve seat limits risk of leaks by efficient clearance of foreign matter.
5. Dimensions make the group interchangeable with the major safety groups on the market.
6. Swivelling air gap designed to protect the wall from water splashes regardless of the type of mounting.
7. For water tanks up to 10 kW maximum useful power.

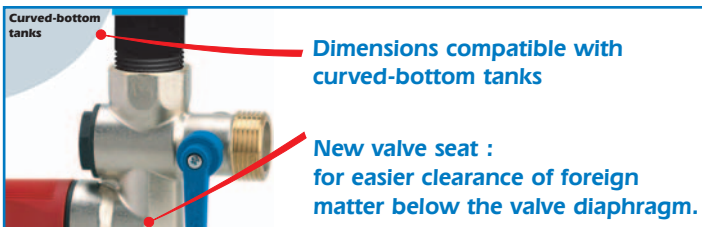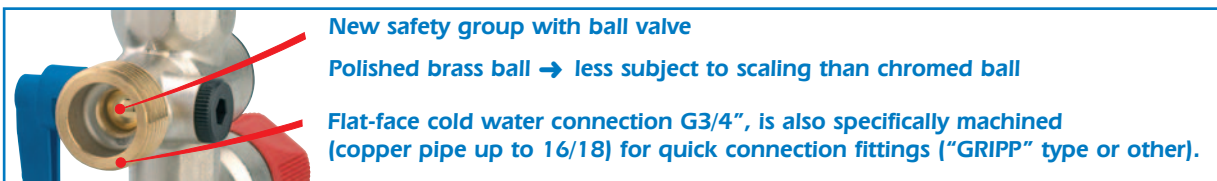

Ref. : 52350
under blister
for self-service


SFR 3/4"
STAINLESS STEEL NF
+ Trap funnel kit NF
+ Pressure reducing valve
Redufix

◆ DESIGN

- 1 Female port, Ø 3/4" 20x27 for mounting on the water heater with a Dielectric Insulating Connection (WATTS INDUSTRIES "RID").
- 2 Check valve inspection port.
- 3 Check valve : built into safety group to allow intake of cold water into hot water system and stop return of hot water into the mains.
- 4 Quarter-turn isolating ball valve.
- 5 Expansion relief valve : limits pressure in the water heater. Set to 7 bar. Instant opening, "POP" effect, guarantees very high outflow rate.
- 6 Water guide : nozzle profile prevents any risk of splashing.
- 7 Safety valve discharge port with air gap. 1" thread (26 x 34).



◆ DIMENSIONS (in mm)

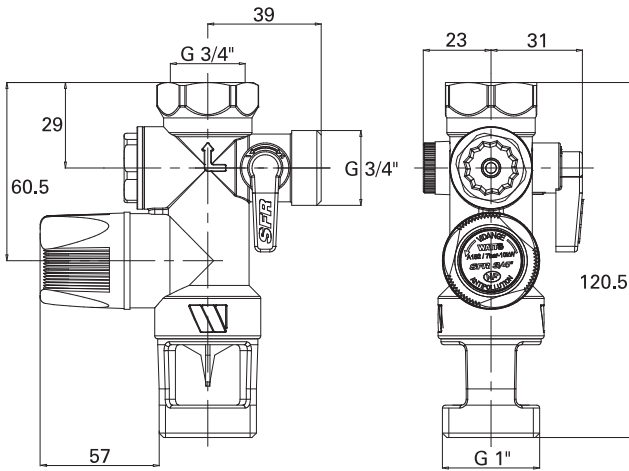

◆ PARTS LIST

Name	Material
Machined body	Brass CW617N
Ball-valve seal	VIRGIN PTFE
Valve membrane	EPDM 70Sh
Valve knob	PA 6
Valve seat	Stainless steel 304L
Air gap	PA 6.6 30% GF
Valve ball	Brass CW614N
Drain plug	POM
Check valve TR20	Grivory HTV
Weight	0,360 kg

◆ REFERENCE

Type : SFR STAINLESS STEEL Reference : 52570

◆ CONNECTIONS

Inlet 3/4" M, outlet 3/4" F, discharge 1" M.

◆ RECOMMENDATIONS / INSTALLATION

Water heater working normally

The stop valve is in the "open" position and the valve is in the "on" position under normal working.

During heating, pressure rises inside the water heater and the nonreturn valve closes.

When the pressure reaches 7 bar, the safety valve opens slightly and allows some water to escape and this occurs intermittently throughout the heating time.

Exhausting water like this is normal ; it proves that the Safety Group is working correctly.

There is no need for troubleshooting and remedies.

Water heater working abnormally

The water heaters thermostat can malfunction and fail to cut off the heat source.

This causes pressure and temperature to rise which lifts the valve in the safety group allowing steam to escape with a characteristic whistle.


You should cut off the water heater power source immediately and contact the installer who will change the thermostat.

The safety group should be replaced: the temperature of steam at 7 bar is 165°C and could damage the valve seals.


Frost

If you are using your water heater when there is a risk of frost, it is recommended that you empty it: turn off the power source, close the Safety Group stop valve, open one of the hot water taps of the system and open the drain valve.

◆ PRESSURE DROP CURVE / HEADLOSS

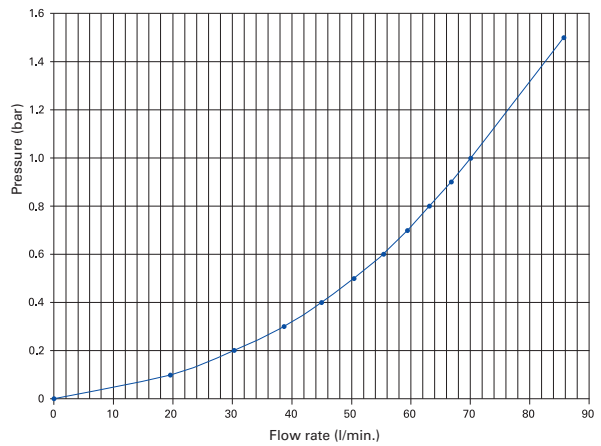

◆ TYPICAL INSTALLATION

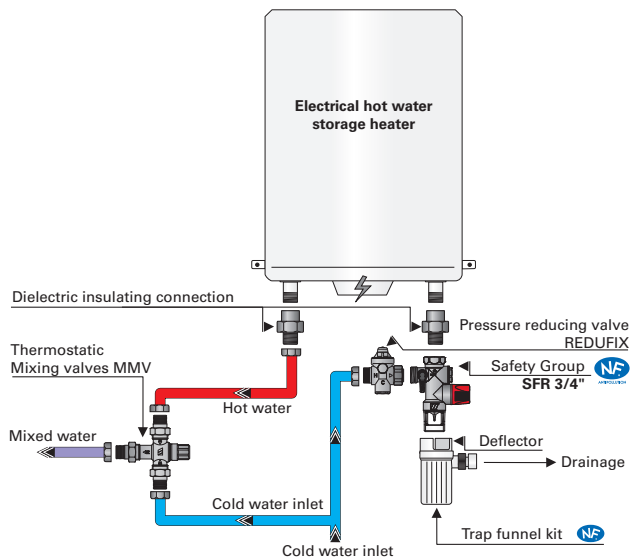

Impurities

If the Safety Group keeps on emptying itself, the drain valve should be opened several times to blow off the impurities blocking the seal.

Maintenance

If properly fitted, the safety group needs no maintenance. However, we recommend that the drain valve be opened at least once a month.

Recommendations / Installation

- 1 - Make sure there is no seal mastic, oakum or other waste preventing its proper working.
- 2 - Operate the isolating valve and safety valve at least once a month.
- 3 - The drain pipe should be 25 mm minimum. A suitable tundish/airgap (not supplied) should be fitted.
- 4 - If the cold water supply pressure exceeds 3 bar, a pressure reducing valve should be fitted UPSTREAM of the safety group. Please refer to the range available from Watts Industries.
- 5 - This Safety Group may be fitted to a water heater of maximum 10 kW working power.
- 6 - Subject to plumbing regulations.
- 7 - To prevent the two metal corrosion phenomenon, fitting Dielectric Unions on piping between the water heater and the safety group as well as the water heater hot water outlet is recommended. Please refer to the range available from Watts Industries.

Head office and factory

13, rue J.J. Rousseau.
B.P. 90007 Tel. 03 22 60 39 80
80390 FRESSENNEVILLE Fax 03 22 60 39 89

Commercial services

06, avenue Gustave Eiffel Tel. 02 37 25 11 00
B.P. 40339 Fax 02 37 25 11 11
28006 CHARTRES Cedex Fax 02 37 25 11 44

